

FILL CHART


Material Location	Description	Material Classification	Compaction/Density Requirement (NOTE 3)
FINAL FILL Fill starting from the top of the embedment fill layer. (NOTE 1 and 2)	Suitable Fill Materials as noted in the Project Geotechnical Report and noted on the Site Design Engineer's Plans	See Project Geotechnical Report and Site Design Engineer's Plans	Plate Compact or Static Roll loose lifts to densify fill. Use at least two full passes of the equipment to level the layer. Continue until 24 inches of total fill thickness has been placed above the tank. For AASHTO M145 soils, a minimum of 95% of the Standard Proctor Maximum Dry Density is recommended. After 24 inches of fill is placed, place fill in accordance with the engineer of record's relative compaction requirement or to 95% of the Standard Proctor Maximum Dry Density - whichever is greater.
EMBEDMENT FILL Fill Immediately Surrounding the sides and top of tank (NOTE 4)	Sand-Gravel Mixtures or Open-Graded Crushed Aggregate Blends	AASHTO M145 A-1, A-2-4, A-3 or AASHTO M43 3, 357, 4, 467, 5, 56, 57	Plate Compact or Static Roll loose lifts to densify fill. Use at least two full passes of the equipment to level the layer. For AASHTO M145 soils, a minimum of 95% of the Standard Proctor Maximum Dry Density is recommended.
BEDDING FILL Fill Immediately below the tank (NOTE 4)			

NOTE 1: This layer can include pavement subbase
 NOTE 2: If open-graded aggregates are used for embedment fill, fines migration from the final to embedment fill layer may be reduced by installing a layer of 6 oz non-woven geotextile fabric at the final and embedment fill interface.
 NOTE 3: See Construction Equipment Table for more information for construction equipment limitations.
 NOTE 4: Import or native soils may be used if the soils meet the material classification listed. Fill material should be selected based on classification, groundwater conditions, and tank invert elevation.

CONSTRUCTION EQUIPMENT CHART

Equipment Make (NOTE 1)	Maximum Gross Vehicle Weight (lbs)	Minimum Fill Depth over Tank (in)
Plate Compactor	1,500	6
Compact Track Loader (NOTE 2)	7,500	6
Rubber-Tired Skid Steer (NOTE 3)	7,500	14
Low Ground Pressure Tracked Vehicles (NOTE 4)	20,000	14
Roller - Static Mode	12,000	18
Roller - Vibratory Mode	12,000	24
Dump Trucks and Pans	NOTE 5	

NOTE 1: Vehicles shall make straight runs only across tank footprint.
 NOTE 2: Maximum ground pressure = 5 psi
 NOTE 3: Maximum axle load = 5,250 lbs
 NOTE 4: Maximum ground pressure = 7 psi
 NOTE 5: Contact ACO for more information regarding dump truck and pan traffic during construction.
 NOTE 6: Backfill material may be temporarily unloaded near the excavation. Material shall not be stockpiled near the excavation for longer than 24 hours.

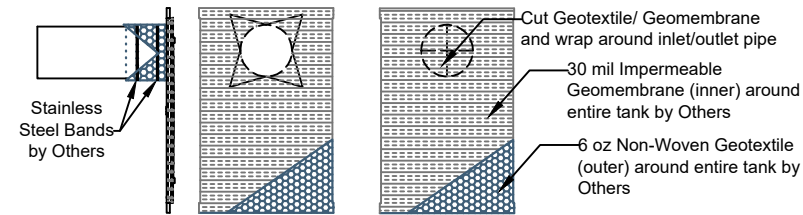

DETAIL A - PIPE WRAP

NTS

COVER CHART


Live Loading Condition	Cover Thickness (inches)	
	Minimum	Maximum
Non-Trafficked Areas (i.e. Landscaping)	12	54
Passenger Vehicles Parking Lot (i.e. Gross Vehicle Weight <10,000 lbs)	18	54
Passenger Vehicle Parking Lot with one weekly AASHTO HS-20 vehicle	24	54
Frequent AASHTO HS-20 Traffic	26	54

NOTE 1: Minimum Cover Thickness in non-trafficked areas is based on landscape surface with a 40 degree load distribution. In trafficked areas, Minimum Cover Thicknesses are based on an asphalt-surfaced pavement with a 30 degree load distribution.
 NOTE 2: Calculations assume backfill with a minimum 32-degree angle of internal friction and a maximum density of 120 lbs per cubic foot, and a seasonal groundwater elevation at least 2 feet below the invert of the tank.

SIDE PANEL PIPE DIAMETER CHART

Module Type	Inlet/Outlet Pipe Diameter	
	Minimum	Maximum
900SD	4 inches	24 inches (Note 2)
300SD	4 inches	6 inches


NOTE 1: Cut inlet / outlet pipe hole prior to side panel installation.
 NOTE 2: Pipe holes should be aligned with the vertical centerline of the side panel. For pipes larger than 18 inches, center the pipe hole along the seam of two side panels.
 NOTE 3: Contact ACO for guidance for inlet / outlet pipes larger than 24-inch diameter

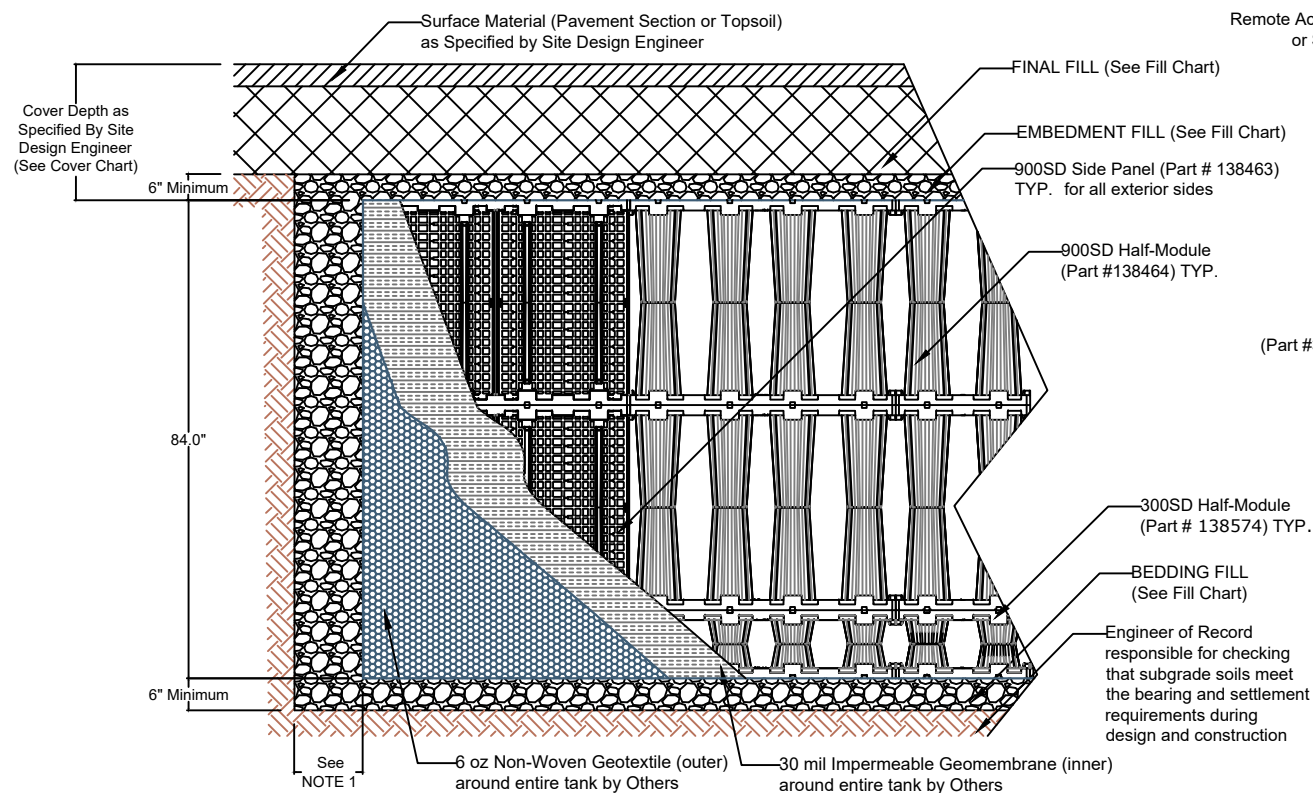

2 LAYER 900SD - 1 LAYER 300SD DETENTION CROSS SECTION

NTS


NOTE 1: The minimum width of sidewall backfill is 12" or large enough to accommodate selected compaction equipment, whichever is greater.

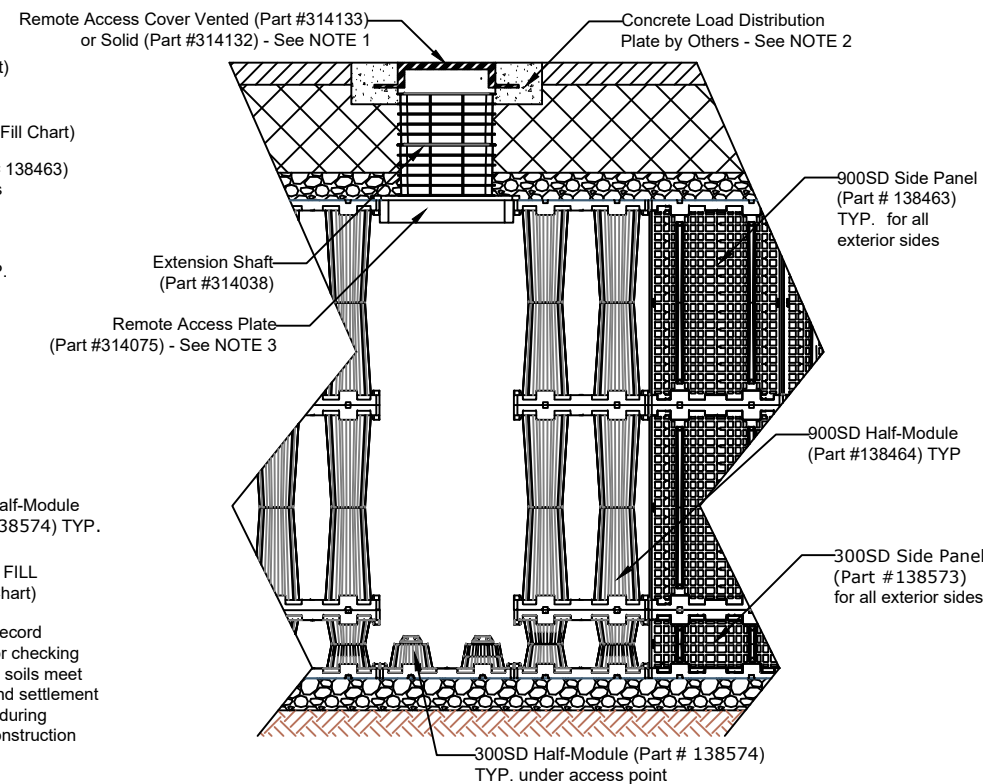

2 LAYER 900SD - 1 LAYER 300SD ACCESS POINT CROSS SECTION

NTS

NOTE 1: Ventilation may be crucial to reducing the pressure build up within the system. If solid access covers are used, alternative methods of ventilation are recommended.
 NOTE 2: Concrete Load Plate not required for unpaved applications. Consult Engineer of Record for requirements
 NOTE 3: The Remote Access Plate is approximately the size of half of a half-module. The half-module at the top of the tank must be cut in half to accommodate the Remote Access Plate

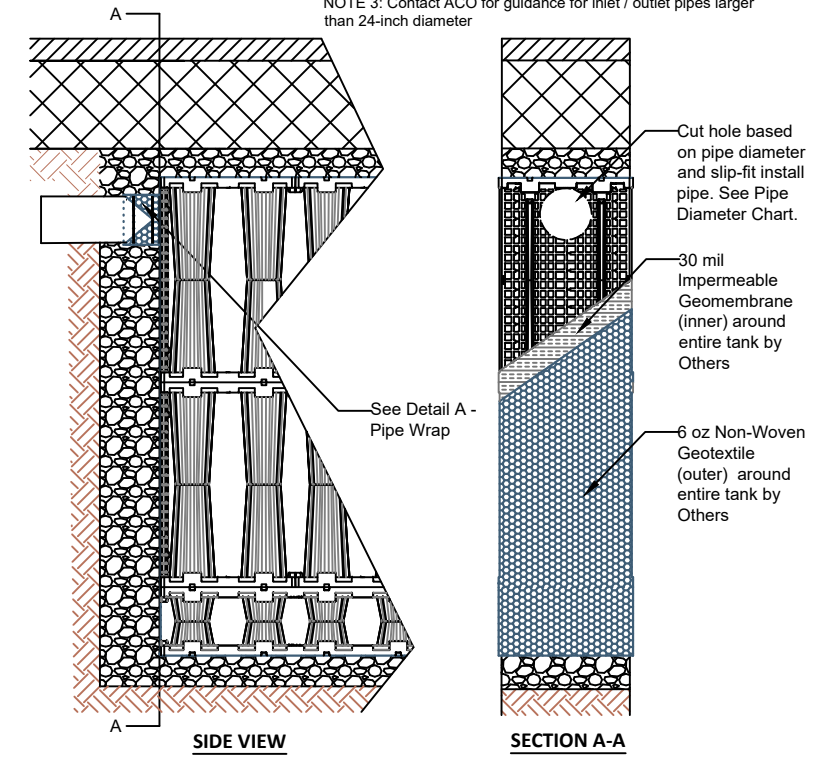

2 LAYER 900SD - 1 LAYER 300SD PIPE INSTALLATION

NTS

DRAWN BY A Frye	CHECKED BY J Jonke
DATE 12/23/2024	REV. 3

STORMBRIXX STANDARD DETAILS
SYSTEM - 2 LAYER 900SD - 1 LAYER 300SD - DETENTION



ACO, INC.

WEST SALES OFFICE
 825 W BEECHCRAFT ST.
 CASA GRANDE, AZ 85122
 Tel. (888) 490-9552
 Fax (520) 421-9899

EAST SALES OFFICE
 9470 PINECONE DRIVE
 MENTOR, OH 44060
 Tel. (800) 543-4764
 Fax (440) 639-7235

SOUTHEAST SALES OFFICE
 481 MUNN RD. SUITE #225
 FORT MILL, SC 29715
 Tel. (440)-639-7230
 Fax (803)-802-1063

www.acoswm.com